


10532272



Europäisches Patentamt
European Patent Office
Office européen des brevets



(11) **EP 1 221 701 A1**

(12) **EUROPEAN PATENT APPLICATION**

(43) Date of publication:
10.07.2002 Bulletin 2002/28

(51) Int Cl.⁷: **G21D 3/04**

(21) Application number: **01310704.0**

(22) Date of filing: **20.12.2001**

(84) Designated Contracting States:
**AT BE CH CY DE DK ES FI FR GB GR IE IT LI LU
MC NL PT SE TR**
Designated Extension States:
AL LT LV MK RO SI

- **Andersen, Jens George Munthe**
Wilmington, North Carolina 28409 (US)
- **Heck, Charles Lee**
Wilmington, North Carolina 28411 (US)
- **Shaug, James Courtney**
Morgan Hill, California 95037 (US)

(30) Priority: **29.12.2000 US 750289**

(71) Applicant: **Global Nuclear Fuel-Americas, LLC**
Wilmington, North Carolina 28402 (US)

(74) Representative: **Pedder, James Cuthbert**
GE London Patent Operation,
Essex House,
12/13 Essex Street
London WC2R 3AA (GB)

(72) Inventors:
• **Bolger, Francis Thomas**
Wilmington, North Carolina 28409 (US)

(54) **Determination of operating limit minimum critical power ratio**

(57) A method and system for thermal-dynamic modeling and performance evaluation of a nuclear Boiling Water Reactor (BWR) core design is presented. A data processing system is used to execute specific program routines that simultaneously simulate the thermal operating characteristics of fuel rods within the reactor during a transient operational condition. The method employs a multi-dimensional approach for the simulation of postulated operational events or an anticipated operational occurrence (AOO) which produces a transient condition in the reactor—such as might be caused by single operator error or equipment malfunction.

Based on a generic transient bias and uncertainty in the change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$), histograms of fuel rod critical power ratio (CPR) are generated. Ultimately, the operating limit minimum critical power ratio (OLMCPR) of the reactor is evaluated from a histogram of probability calculations representing the number of fuel rods subject to a boiling transition (NRSBT) during the transient condition. The histogram may be readily displayed by the data processing system and used to statistically demonstrate an OLMCPR compliance of the reactor core design with USNRC regulations.

EP 1 221 701 A1

Description

[0001] The present invention relates generally to methods for evaluating nuclear power core operation, and more particularly to an improved method and apparatus for determining an operating limit minimum critical power ratio (OL-MCPR) so as to effectuate increased efficiency and operation of Boiling Water Reactors (BWR).

[0002] A Boiling Water Nuclear Reactor (BWR) generates power from a controlled nuclear fission reaction. As shown in Figure 1, a simplified BWR includes a reactor chamber 101 that contains a nuclear fuel core and water. Generated steam is transferred through pipe 102 to turbine 103, where electric power is generated, then water returns to the core through pipe 104. As shown in Figure 2, the core 201 is made of approximately five hundred (500) bundles 202 of fuel rods arranged in a specific manner within the reactor core. As shown in Figure 3, each bundle 301 contains roughly one hundred (100) fuel rods 302. Water in the core surrounds the rods. Heat generated by a nuclear reaction is transferred from the rods to the water circulating through the core, boiling some of the water. The heat generated in the core is carefully controlled to maintain safe and efficient reactor operations.

[0003] In a Boiling Water nuclear Reactor there are basically three modes of heat transfer that must be considered in defining thermal limits for the reactor: (i) Nucleate boiling, (ii) transition boiling and (iii) film boiling. "Nucleate boiling" is the preferred efficient mode of heat transfer in which the BWR is designed to operate. "Transition boiling" is manifested by an unstable fuel rod cladding surface temperature which rises suddenly as steam blanketing of the heat transfer surface on the rod occurs, then drops to the nucleate boiling temperature as the steam blanket is swept away by the coolant flow, and then rises again. At still higher fuel rod/bundle operating powers, "film boiling" occurs which results in higher fuel rod cladding temperatures. The cladding temperature in film boiling, and possibly the temperature peaks in transition boiling, may reach values which could cause weakening of the rod cladding and accelerated corrosion. Fuel rod overheating is conservatively defined as the onset of the transition from nucleate boiling to film boiling. The conventional basis for reactor core and fuel rod design is defined such that some "margin," accommodating various design and operational "uncertainties," is maintained between the most limiting operating condition and the transition boiling condition at all times for the life of the core.

[0004] The onset of transition boiling can be predicted by a correlation to the steam quality at which boiling transition occurs—called the "critical quality." Steam quality can be readily measured and is generally a function of measuring distance above the boiling boundary (boiling length) for any given mass flow rate, power level, pressure and bundle flow geometry among other factors. A "critical power" is defined as that bundle power which would produce the critical quality of steam. Accordingly, a "critical power ratio" (CPR) is defined as the ratio of the critical power to the bundle operating power at the reactor condition of interest. CPR is descriptive of the relationship between normal operating conditions and conditions which produce a boiling transition. CPR is conventionally used to rate reactor design and operation. To assure a safe and efficient operation of the reactor, the CPR is kept above a prescribed value for all of fuel assemblies in the core. Reactor operating limits are conventionally defined in terms of the most limiting fuel bundle assembly in the core—defined as the "minimum critical power ratio" (MCPR). Reactor operating limits are often stated in terms of MCPR.

[0005] In nuclear power generation engineering, it is widely recognized that there is a possibility, however small, that the occurrence of a reactor transient event combined with the various "uncertainties" and tolerances inherent in reactor design and operation may cause transition boiling to exist locally at a fuel rod for some period of time. Accordingly, MCPR operating limits are conventionally set in accordance with the United States Nuclear Regulatory Commission (USNRC) design basis requirement that transients caused by a single operator error or a single equipment malfunction shall be limited such that, taking into consideration uncertainties in the core operating state, more than 99.9% of the fuel rods are expected to avoid boiling transition during that error or malfunction. A safety limit minimum critical power ratio (SLMCPR) is defined under current USNRC requirements as the MCPR where no more than 0.1% of the fuel rods are subject to boiling transition. The corresponding OLMCPR describes the core operating conditions such that the MCPR is not lower than the SLMCPR to a certain statistical confidence.

i. An Ideal Approach

[0006] In principle, the OLMCPR could be calculated directly such that for the limiting anticipated operational occurrence (AOO), less than 0.1% of the rods in the core would be expected to experience boiling transition. This approach is described in U.S. Patent No. 5,912,933, by Shaug et al. The process involved is shown in Figure 4, which depicts histogram 400 of rod CPR values 401 verses number of rods 402 at the specific CPR value. While the CPR value is usually associated with a fuel bundle, it actually refers to the limiting rod in a bundle. Each rod in the bundle has a CPR value that is determined by the local power distribution (TIP uncertainty) and relative position of the rod within the bundle (R-factor). The lowest CPR of any one rod in the bundle is used to characterize the CPR for the entire bundle.

[0007] The CPR 401 for a given rod has an associated probability distribution function (PDF) which reflects the uncertainties in its determination. The PDF may be determined experimentally and is shown as an Experimental Critical

Power Ratio (ECPR) distribution 410. Thus, if a nominal CPR value (411) is 1.0, then the PDF 410 of probable actual CPR values range from 0.90 to 1.10. The variability in the rod CPR values is due to uncertainties in the initial rod condition, i.e., uncertainties in the measurements of parameters at the reactor operating state (core power) and in the modeling of derived parameters (power distribution).

[0008] To take the effect of a transient event on the CPR values into account, a safety margin is introduced to CPR values by shifting the acceptable nominal CPR value 405 for the lowest rod CPR to a larger CPR value, i.e., 1.25. The ECPR histogram distribution 403 for the lowest CPR rod is thus shifted such that the entire CPR histogram is above a CPR value of 1.20, and well above a CPR value of 1.0. Moreover, the nominal CPR values 407 for rods other than the lowest CPR rod are above the nominal CPR value, e.g., 1.25, of the lowest CPR rod.

[0009] During a transient in rod operation, the histogram 407 of rod CPRs shifts to the left to lower CPR values, resulting in the histogram 408. With this shift, the "nominal" CPR value 406 during the transient is at the point, e.g., 1.05, where the minimum CPR value is reached during the transient. The limiting rod will have an associated PDF 404, which includes both the uncertainties in the initial rod conditions and "transient uncertainties." The maximum change in critical power ratio during the transient (Δ CPR 409) includes uncertainties in the modeling of the transient, both the physical models and plant parameters. Ideally, this transient Δ CPR 409 and associated OLMCPR would be generated as shown in Figure 5, and described as follows:

Step 1: Assume a set of base core operating conditions using the parameters to run the plant generates a core MCPR equal to the OLMCPR, as shown by block 501.

Step 2: Using the parameters, such as core power, core flow, core pressure and others, that predict a general bundle CPR set forth in block 506, determine the MCPR for each bundle in the core, as shown by block 502.

Step 3: Using parameters, such as rod placement within each bundle and rod power, that change each bundle CPR into individual rod CPR values set forth in block 507, determine the MCPR for each rod in the core, as shown by block 503.

Step 4: Using the ECPR probability distribution, generated by Equations 1 and 2, set forth in block 508, determine the percentage of NRSBT in the core by summing the probabilities of each rod in the core that is subject to boiling transition, as shown by block 504. This summation is shown by Equation 3.

$$\text{ECPR} = \frac{(\text{CriticalPower Predicted by Correlation})}{(\text{Measured CriticalPower})} \quad (\text{Equation 1})$$

$$P_i = P(z_i) = \frac{1}{\sqrt{2\pi}} \int_{z_i}^{\infty} e^{-\frac{1}{2}u^2} du$$

(Equation 2)

$$\text{NRSTB} (\%) = \frac{100}{N_{\text{rod}}} \times \sum_{i=1}^{N_{\text{rod}}} [P_i \times (1\text{Rod})]$$

(Equation 3)

Step 5: Vary the parameters set forth in blocks 506 and 507 for a set number of Monte Carlo statistical trials, as shown by block 505. Compile the statistics from all the trials from steps 2 through 4 to generate a probability distribution of NRSBT.

Step 6: Compare the value of NRSBT percentage to 0.1%, as shown in block 509. If the percentage is greater than 0.1%, reset the core parameters to different initial conditions in order to comply with the USNRC regulations, as shown in block 510. Similar to Step 1 and block 501, the new initial conditions are assumed to generate an OLMCPR. The determination of NRSBT restarts and loops until the value of NRSBT is equal to 0.1%. Similarly, if

EP 1 221 701 A1

the percentage is less than 0.1%, the core parameters are reset to increase the value of NRSBT in order to operate the core more efficiently or with fewer effluents.

Step 7: If the percentage of NRSBT equals 0.1%, the assumed value of OLMCPR, which equals core MCPR, complies with the USNRC regulations, as shown by block 511. Accordingly, the operating core conditions are set as the assumed parameters.

[0010] Because of the computational difficulties and the need to evolve efficient algorithms, the ideal process outlined above has not been followed. The currently approved process and the new approach to determining the OLMCPR are described in the following sections.

ii. The USNRC Approved Approach

[0011] In the current process, the OLMCPR determination is divided into primarily two steps, as shown by Figure 6. Using a process similar to the ideal process, first the SLMCPR is determined so that less than 0.1% of the rods in the core will be expected to experience boiling transition at this value. In other words, 99.9% of the fuel rods in the core will be expected to avoid boiling transition if the MCPR in the core is greater than SLMCPR. Second, the OLMCPR is then established by summing the maximum change in MCPR ($\Delta\text{CPR}_{95/95}$) expected from the most limiting transient event and the SLMCPR. Since Figure 6 is similar to the Figure 4, only a brief description of its components follows. Histogram 600 shows the number of rods at a specific CPR value 602 versus the corresponding CPR value 601. The histogram 608 results with the lowest CPR rod 607 at a value of, e.g., 1.05, which equals the SLMCPR 603. Limiting rod distribution 606 shows the uncertainty in determination of the limiting CPR rod 607. Similar to the ideal process, the SLMCPR 603 is determined when the percentage of NRSBT is equal to 0.1%. However, unlike the ideal process, the current process is unable to fully predict and measure certain parameters, such as the power distribution within each bundle and the power distribution along each rod. Thus, the uncertainties in calculating the SLMCPR do not allow equating the OLMCPR with the SLMCPR. Accordingly, an error factor, $\Delta\text{CPR}_{95/95}$ 605, is linearly added to the SLMCPR 603 to determine the OLMCPR 609. $\Delta\text{CPR}_{95/95}$ 605 conservatively corrects for the inherent limitations in the calculation of the SLMCPR 603.

[0012] Using the currently approved process, the OLMCPR 609 is generated as shown in Figure 7, and described as follows:

Step 1: Assume a set of base core operating conditions using the parameters to run the plant generates a core MCPR equal to the SLMCPR as shown by block 701.

Step 2: Using the parameters, such as core power, core flow, core pressure, bundle power and others, that predict a general bundle CPR set forth in block 706, determine the MCPR for each bundle in the core as shown by block 702. This process step has large uncertainties in predicting the bundle power, biasing the calculations.

Step 3: Using parameters, such as rod placement within each bundle and rod power, which change each bundle CPR into individual rod CPR values set forth in block 707, determine the MCPR for each rod in the core, as shown by block 703. Individual rod power is difficult to measure; combining that uncertainty with bundle power distribution uncertainty serves to increase the uncertainty in practical calculations of the SLMCPR.

Step 4: Using the ECPR probability distribution set forth in block 708, generated by Equations 1 and 2 shown above, determine the percentage of NRSBT in the core by summing the probabilities of each rod in the core that is subject to boiling transition, as shown by block 704. This summation is performed using Equation 3, shown above.

Step 5: Vary the parameters set forth in blocks 706 and 707 for a set number of Monte Carlo statistical trials, as shown by block 705. Compile the statistics from all the trials from steps 2 through 4 to generate a probability distribution of NRSBT.

Step 6: Compare the value of percentage of NRSBT to 0.1%, as shown in block 709. If the percentage is greater than 0.1%, reset the core parameters to different initial conditions in order to comply with the USNRC regulations, as shown in block 710. Similar to Step 1 and block 701, the new initial conditions are assumed to generate the SLMCPR. The determination of NRSBT loops until the value of NRSBT is equal to 0.1%. Similarly, if the percentage is less than 0.1%, the core parameters are reset to increase the value of NRSBT in order to operate the core more efficiently.

Step 7: If the percentage of NRSBT equals 0.1%, the assumed value of SLMCPR, which equals core MCPR, is the limit at which the core may operate, as shown by block 711.

Step 8: Since this process includes relatively uncertain simulations in steps 2 and 3, as shown by blocks 702 and 703, the change in CPR is evaluated at a 95% confidence interval, $\Delta\text{CPR}_{95/95}$. The OLMCPR equals the linear addition of the SLMCPR to the $\Delta\text{CPR}_{95/95}$. The resulting value of the OLMCPR complies with the USNRC regulations.

[0013] Motivated by the difficulties in calculating OLMCPR directly and the overly conservative approximation technique currently used, the inventors were led to examine more closely some of the processes conventionally used in evaluating BWR designs and calculating OLMCPR. For example, the following is a brief list summarizing two of the most prominent factors identified by the inventors as constraining the ability to calculate OLMCPR directly using the ideal method:

1. The number of calculations necessary to evaluate each AOO would be too cumbersome. To establish a statistically sound estimation of the NRSBT, approximately one hundred trials for each AOO would have to be performed. The currently-available equipment has inherent limitations that prevent the requisite number of transient calculations from being performed within the necessary timeframe.

2. The currently-available equipment cannot simulate local power distribution (TIP uncertainty) or the relative position of the rod within the fuel bundle (R-factor). The variations within each rod bundle are essential to compute an accurate NRSBT. Without a precise method of estimating the effects of the variations, a direct calculation of OLMCPR would be unavoidably inaccurate.

[0014] Due to the excessive degree of conservatism inherent in the conventional basis used for evaluation of BWR operations, a substantial increase in the operating margin for a BWR can be realized by using other approaches toward determining the OLMCPR. Applicants have developed a mathematically-sound approach to determining OLMCPR that allows for a substantial increase in the permissible operating margin for a reactor and increased operating efficiency, greater fuel generation and/or lowered fuel exhaustion. For example, demonstrating that a particular reactor or reactor design actually has a greater operational margin than may have been previously realized, e.g., due to the use of an unnecessarily conservative evaluation method, could permit operation at increased output power levels or at comparable power output levels using less fuel. Accordingly, a more mathematically-sound evaluation method that results in a substantially greater operational margin for Boiling Water Reactors is presented herein for calculating and demonstrating the OLMCPR.

[0015] Briefly, the improved method of the present invention is based on producing a histogram of the number of reactor fuel rods susceptible to operation at "boiling transition" temperatures over a range of variations in selected parametric quantities that are indicative of reactor design constraints and operating conditions. In addition, a core operational modeling approach using predetermined PDFs of the change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for each type of transient event specific to the type of BWR is employed for simulating BWR thermal hydraulics and neutron kinetics during an "anticipated operational occurrence" or AOO in the reactor (for example, a operational occurrence that causes a brief power transient). Basically, in the present invention, all model and reactor plant parameters that may affect the number of rods subject to boiling transition (NRSBT) are taken into account in projecting the PDF of the NRSBT. The NRSBT is then evaluated statistically in order to determine the OLMCPR directly without the need for first calculating a value for the SLMCPR. Using this approach, the present invention achieves a direct evaluation of OLMCPR of the reactor from a statistical analysis of histograms for the transient condition—as opposed the conventional "indirect" approach of determining an OLMCPR from a combination of values obtained by separately evaluating both a steady-state SLMCPR and the change in the critical power ratio (ΔCPR) due to a transient operational occurrence.

[0016] The invention will now be described in greater detail, by way of example, with reference to the drawings, in which:-

Figure 1 is a schematic diagram of a simplified boiling water nuclear reactor.

Figure 2 is a cross-sectional diagram depicting an arrangement of multiple fuel rod bundles within a core of a BWR.

Figure 3 is a schematic cross-sectional diagram of an arrangement of fuel rods within a single fuel bundle.

Figure 4 is a graph showing the determination of the NRSBT according to the ideal process.

Figure 5 is a flow chart illustrating a sequence of processing steps executable by a data processing system for performing an evaluation of OLMCPR using the ideal process.

Figure 6 is a graph showing the linear addition of ΔCPR to the SLMCPR to determine OLMCPR, which is the currently approved process.

Figure 7 is a flow chart illustrating a sequence of processing steps executable by a data processing system for performing an evaluation of the OLMCPR using the currently approved process.

Figure 8 is a block diagram of an example data processing system used for multi-dimension/modeling of BWR thermal hydraulics and indirect evaluation of an OLMCPR for a BWR in accordance with the present invention.

Figure 9 is a flow chart illustrating a sequence of processing steps used in calculating the OLMCPR using the generic uncertainty in $\Delta\text{CPR}/\text{ICPR}$.

Figure 10 is a graph showing the determination of generic uncertainty in $\Delta\text{CPR}/\text{ICPR}$ using the present invention.

Figure 11 is a graph showing the determination of the NRSBT using the generic uncertainty of $\Delta\text{CPR}/\text{ICPR}$.

Figure 12 is a graph showing the comparison of the process of the present invention to the ideal process.

Figure 13 is a graph showing the transformation of ICPR distribution to transient MCPR.

[0017] A practical method for determining the operating limit minimum critical power ratio (OLMCPR) of a Boiling Water Reactor (BWR) nuclear core is disclosed here. This practical improvement results in the realization of greater operating margins for the core which in turn results in more efficient and cost effective core operation and/or configurations. This is a more direct approach towards demonstrating compliance of a nuclear reactor with USNRC licensing requirements than processes conventionally used for such purposes. A data processing system is disclosed including a computer having memory and various I/O or display devices that is specifically programmed for providing simulation of transient operational events in a BWR and for a subsequent compilation and display of one or more response histogram(s) that incorporate all the inherent "uncertainties" associated with reactor plant initial state conditions and other parameter(s) of interest or importance.

[0018] A method is used to calculate a generic bias in change in critical power ratio during a transient event ($\Delta\text{CPR}/\text{ICPR}$) and uses the resulting Probability Distribution Function (PDF) to predict a more accurate OLMCPR without first calculating a SLMCPR. From a large number of experimental trials that take many factors into account, a PDF for the transient $\Delta\text{CPR}/\text{ICPR}$ is created and the standard deviation in $\Delta\text{CPR}/\text{ICPR}$ is determined for each transient event. A nominal $\Delta\text{CPR}/\text{ICPR}$ for the transient event starting from nominal initial conditions is also determined. Histograms of individual rod CPR values for the minimum point in the transient are created by drawing random values of initial CPR and transient $\Delta\text{CPR}/\text{ICPR}$ uncertainty. The initial critical power ratios (ICPR) are converted, or translated, to MCPRs by a common random value of $\Delta\text{CPR}/\text{ICPR}$. From the MCPR values, the percentage of NRSBT is calculated for each trial. If the percentage of NRSBT is greater than 0.1%, initial operating conditions are changed and the process is repeated until the NRSBT is equal to 0.1%.

[0019] The NRSBT distribution histogram is analyzed using statistical methods to determine the "central tendency" of the distribution. Typically the mean or median is used as a statistic to quantify central tendency. The value of this statistic is defined here as the nominal value. In the discussions that follow, examples are given where the mean value is chosen as the nominal value although the present invention is not limited to this choice. Use of the median value or the value of some other statistic for central tendency as the nominal value is also contemplated as part of the present invention.

[0020] The uncertainty in the nominal value of the statistic that is used to quantify central tendency is expressed in terms of a "confidence interval" for the nominal value. A confidence interval is defined such that there is a specified probability (usually of 50% or greater) that the interval contains the nominal value. For example, a 95% probability that the interval bounds the mean, defines a 95% confidence interval for the mean. The specified probability used to establish this confidence interval is called the "level of confidence" or confidence level.

[0021] The susceptibility to boiling transition during the transient is quantified statistically as either (1) the probability that a single rod in the core is susceptible to boiling transition or (2) the expected fraction of total rods in the core susceptible to boiling transition. Such a statistical relationship is possible because each individual trial value of NRSBT has been determined by summing the probabilities that individual fuel rods have CPR values less than 1.0 during the transient. The nominal value for each NRSBT distribution can also by the present invention be associated with the

distribution of initial rod CPR values for all fuel rods in the core. It is by this process that a relationship can be established between the minimal initial MCPR value for all fuel rods in the core and the probability and confidence level that the fuel rods will be susceptible to boiling transition during the transient. The minimal initial MCPR value for the core when determined in this way using the probability and confidence level established by the USNRC design basis requirement for the number of rods not susceptible to boiling transition during the AOO transient, is by definition, the minimum Operating Limit MCPR required to demonstrate compliance.

[0022] In accordance with one aspect, the present invention is a system including a data processing apparatus programmed to execute specific routines for simulating BWR core operating conditions and for calculating and statistically demonstrating the OLMCPR of a reactor in accordance with the improved method of the present invention as described in detail below.

[0023] Figure 8 shows a block diagram of an example data processing system, contemplated for performing the multi-dimensional simulation of reactor core transient response and for the direct evaluation of OLMCPR for a BWR reactor core in accordance with the present invention. Essentially, the system includes a central processing unit 801 (CPU), a storage memory 802, and a user interfacing I/O devices 803 and, optionally, one or more displays 804. Storage memory 802 includes a data base (not shown) of reactor plant state information, parameter values and routines for implementing multi-dimensional simulations of core operating conditions and evaluating OLMCPR in accordance with the improved method of the present invention as described herein below.

[0024] A statistical study will be performed for each type of AOO, for each class of BWR plant type, and for each fuel type to determine the generic transient bias and uncertainty in the $\Delta\text{CPR}/\text{ICPR}$. Enough trials (on the order of one hundred) are made starting with the nominal conditions, using random variations in the model and plant parameters. Uncertainties in initial conditions that contribute to the $\Delta\text{CPR}/\text{ICPR}$ (e.g., core power) are also included in the perturbations. The data are utilized to determine bias and standard deviation on the transient $\Delta\text{CPR}/\text{ICPR}$.

[0025] A flow chart for the process of the present invention is shown in Figure 9. Block 909 remains unvaried throughout the calculation of the OLMCPR, and the $\Delta\text{CPR}/\text{ICPR}$ for individual transient events for each reactor type and fuel type must be determined before the process is used. Figure 10 shows the resulting graph of $\Delta\text{CPR}/\text{ICPR}$ for one specific type of AOO. Histogram 1000 shows the number of trials 1002 with a resulting CPR 1001 for each rod versus the corresponding CPR 1001 values. The PDF 1003 represents the distribution of CPR before the transient event. Each CPR value then changes according to individual $\Delta\text{CPR}/\text{ICPR}$ 1006 values. The aggregate of the transient CPR values yields the PDF 1004 during the transient event. The nominal $\Delta\text{CPR}/\text{ICPR}$ 1005 is defined to be the difference in the nominal CPR value of the PDF 1003 and the nominal CPR value of the PDF 1004. The calculation of the OLMCPR is as follows.

Step 1: Assume a set of base core operating conditions using the parameters to run the plant generates a core MCPR equal to the OLMCPR as shown by block 901.

Step 2: Using the parameters, such as core power, core flow, core pressure, bundle power and others, that predict a general bundle CPR set forth in block 907, determine the ICPR for each bundle in the core, as shown by block 902.

Step 3: Using parameters, such as rod placement within each bundle and rod power distribution, that change each bundle CPR into individual rod CPR values set forth in block 908, determine the ICPR for each rod in the core, as shown by block 903.

Step 4: Using a randomly drawn individual $\Delta\text{CPR}/\text{ICPR}$ 1006 value from the graph of the appropriate transient represented in Figure 10, MCPR values are projected for corresponding values of ICPR according to Equation 4. In Figure 11, this process is represented by Shift 1109. Histogram 1100 shows the number of rods at a specific CPR value 1102 versus the corresponding CPR value 1101. The histogram 1107 is translated to histogram 1108 during the transient using a randomly selected $\Delta\text{CPR}/\text{ICPR}$ 1006 value. Lowest CPR value 1105 becomes lowest CPR value 1106, and lowest CPR rod PDF 1103 becomes lowest CPR rod 1104.

$$\text{MCPR}_i = \text{ICPR}_i \left(1 - \left(\frac{\Delta\text{CPR}}{\text{ICPR}} \right)_i \right)$$

(Equation 4)

Step 5: Using the ECPR probability distribution shown as PDF 1104 and set forth in block 910, determine the

EP 1 221 701 A1

percentage of NRSBT in the core by summing the probabilities of each rod in the core that is subject to boiling transition as shown by block 905. This summation is performed using Equation 3, shown above.

Step 6: Vary the parameters set forth in blocks 907 and 908 for a set number of Monte Carlo statistical trials as shown by block 906. Compile the statistics from all the trials from steps 2 through 5 to generate a probability distribution of NRSBT.

Step 7: Compare the value of percentage of NRSBT to 0.1% as shown in block 911. If the percentage is greater than 0.1%, reset the core parameters to different initial conditions in order to comply with the USNRC regulations as shown in block 912. Similar to Step 1 and block 901, the new initial conditions are assumed to generate the OLMCPR. The determination of NRSBT restarts and runs until the value of NRSBT is equal to 0.1%. Similarly, if the percentage is less than 0.1%, the core parameters are reset to increase the value of NRSBT in order to operate the core more efficiently or to reduce effluents.

Step 8: If the percentage of NRSBT equals 0.1%, the assumed value of OLMCPR, which equals core MCPR, complies with the USNRC regulations as shown by block 913. Accordingly, the operating core conditions are set as the assumed parameters.

[0026] Two assumptions are made for the above estimation of OLMCPR. First, in performing step 4, shown in Figure 11 as shift 1109 and in Figure 9 as block 904, the inventors assume that random draws from the $\Delta\text{CPR}/\text{ICPR}$ distribution are permissible for a perturbation in the initial conditions. Therefore, variations in $\Delta\text{CPR}/\text{ICPR}$ must be independent of perturbations in initial conditions or have a negative correlation, so that the interaction tends to diminish the individual effects. Second, in performing step 4, the inventors assume that the transient change in the $\Delta\text{CPR}/\text{ICPR}$ applies to all rods.

[0027] A demonstration analysis shows that the $\Delta\text{CPR}/\text{ICPR}$ is not sensitive to the uncertainty in core power, core flow, core pressure, feedwater temperature, and rod peaking factor (R-factor). Of these, one of the most important parameters in the currently approved process is core power. This parameter actually results in an effect opposite the effect on ICPR. If the power increases, the ICPR will decrease but the $\Delta\text{CPR}/\text{ICPR}$ will also decrease. This will result in an MCPR that would be higher than derived through the currently approved process. Another conservative factor is the intended use of the nominal $\Delta\text{CPR}/\text{ICPR}$. If the core was adjusting to a limiting rod pattern to maximize the number of contributing bundles, as is done for the currently approved process, the $\Delta\text{CPR}/\text{ICPR}$ is 4% lower.

IMPACT OF CRITICAL ICPR UNCERTAINTIES ON $\Delta\text{CPR}/\text{ICPR}$ (Table 1)

Quantity	Uncertainty in Quantity	$\Delta\text{CPR}/\text{ICPR}$ impact at 1σ (%)
Total Core Power	$+1\sigma = +2\%$ $-1\sigma = -2\%$	-0.6% +0.7%
Total Core Flow	$+1\sigma = +2.5\%$ $-1\sigma = -2.5\%$	+4.4% -0.2%
Steam Dome Pressure	$+1\sigma = +0.7\%$ $-1\sigma = -0.7\%$	-0.5% +0.6%
Feedwater Temperature	$+1\sigma = +0.8\%$ $-1\sigma = -0.8\%$	+0.3% -0.3%
R-factor	$+1\sigma = +1.6\%$ $-1\sigma = -1.6\%$	-0.5% +0.5%
Radial Power Distribution (increase radial peaking with SLMCPR type limiting rod pattern)	$+1\sigma = 3.19\%$	-5.0%
(column 101)	(column 102)	(column 103)

[0028] Table 1 shows the impact of uncertainty in critical ICPR values on $\Delta\text{CPR}/\text{ICPR}$ values. Column 101 lists the critical parameter quantities that affect the $\Delta\text{CPR}/\text{ICPR}$. Column 102 lists the percentage uncertainty of each parameter corresponding to the standard deviation of the associated PDF. σ is the standard deviation of the PDF corresponding to the uncertainty in parameter quantity. Column 103 lists the change in the $\Delta\text{CPR}/\text{ICPR}$ corresponding to a change of one standard deviation of each parameter.

[0029] The $\Delta\text{CPR}/\text{ICPR}$ is not sensitive to the other unknown parameter in the currently approved process. The axial power distribution is also part of the local power distribution (TIP uncertainty) calculation in the currently approved process. For a very large change in axial power shape (nearly two times higher power in the bottom of the bundle), the sensitivity to $\Delta\text{CPR}/\text{ICPR}$ is less than 2%, which is insignificant relative to TIP uncertainty.

[0030] The other assumption to be validated is that a constant value of $\Delta\text{CPR}/\text{ICPR}$ can be applied to rods at different ICPR values. As described above, the transient MCPR distribution will be obtained by transforming the ICPR distribution using Equation 4.

[0031] To further validate this assumption, a specific set of calculations were performed. Benchmark calculations were made for a transient event that included the uncertainties in core power and channel pressure drop as initial conditions, as well as uncertainties in the model. Core power and channel pressure drop uncertainties were chosen, because they are the only currently approved process compatible uncertainties that are also varied in generating the generic uncertainty probability distribution function. MCPR distributions during the transient were generated for two fuel bundles in the core through ninety-eight transient calculations. The two bundles are very close in ICPR values and have identical $\Delta\text{CPR}/\text{ICPR}$ values.

[0032] To verify the translation process, ninety-eight Monte Carlo calculations were then performed where only the core power and pressure drop were varied to generate a PDF of ICPRs at the initial operating state. Figure 12 shows histogram 1200, which is the number of rods 1202 at a certain CPR versus the corresponding CPR 1201 value. PDF 1203 is the ICPR distribution that was created using the Monte Carlo calculations varying core power and pressure drop. PDF 1205 is the corresponding transient MCPR distribution after the process of the invention transformation was applied. PDF 1204 is the reference ICPR distribution. PDF 1206 is the transient MCPR distribution when applying the currently approved process. PDF 1205 and PDF 1206 are very similar in both the most probably value of MCPR and the associated standard deviation of each distribution. Since there is a strong resemblance between the two resulting MCPR distributions, the transformation using the process of the invention is valid.

[0033] It has been demonstrated that: (1) the $\Delta\text{CPR}/\text{ICPR}$ is independent relative to the uncertainties that affect the ICPR, or the covariance is such that it is conservative to assume independence and (2) the transient MCPR distribution can be determined by applying the transient $\Delta\text{CPR}/\text{ICPR}$ uncertainty to the rod ICPR distribution using the proposed approach.

[0034] An example of the process of the invention is described by Figure 13. In Figure 13, histogram 1300 shows the number of rods 1302 of a certain CPR value versus the corresponding CPR value 1301. The PDF 1303 shows the resulting ICPR values from a set of approximately ninety-eight ICPR trials with all uncertainties applied. Ninety-eight new trials were run to generate a $\Delta\text{CPR}/\text{ICPR}$ distribution for the specific transient event in order to translate the ICPR values to MCPR values. This $\Delta\text{CPR}/\text{ICPR}$ distribution is not shown in Figure 13. The $\Delta\text{CPR}/\text{ICPR}$ distribution was applied using the process of the invention to the ICPR PDF 1303 to obtain the MCPR PDF 1304. The NRSBT was determined using the process of the invention, and the OLMCPR was determined to be 1.26. As a comparison, using the currently approved process, the SLMCPR was determined to be 1.10. Thus, the process described herein is more conservative than the first stage of the currently approved process. Ultimately, however, the currently approved process generates a unnecessarily conservative value after the error factor is added to the SLMCPR value, which yields a OLMCPR value needlessly larger than the process of the invention.

[0035] Although the improved methods, as described herein below, are preferably implemented using a high speed data processing system capable of processing simulation routines that require highly accurate calculations and multiple reiterations, the present invention is not intended as limited to any one particular type of computer or data processing system. Any generic data processing system having sufficient, speed, storage memory and programmable computational capabilities for implementing statistical data analysis/reduction may be utilized to implement the present invention.

[0036] For the sake of good order, various aspects of the invention are set out in the following clauses:-

1. A method for direct evaluation of an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR) using computer simulation(s) of postulated operational events and previously determined translations in change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for transient events, said reactor described by one or more parametric quantities indicative of design constraints and operating conditions, comprising the steps:

- a) determining a probability distribution $P(\Delta\text{CPR}/\text{ICPR})$ of potential $\Delta\text{CPR}/\text{ICPR}$ for the class of BRW, operational event, and fuel type;
- b) initializing said parametric quantities to nominal values;
- c) determining steady state initial conditions of reactor operation;
- d) simulating an operational event for a plurality of fuel rods in a BWR core;
- e) calculating a minimum critical power ratio (MCPR) for each fuel rod simulated in step (d) using the probability distribution obtained in step (a);

- f) determining a probability distribution $P(\text{MCPR})$ of potential MCPR values for each MCPR value obtained in step (e);
- g) calculating a value for a total number of fuel rods subject to boiling transition (NRSBT) by summing portions of probability distributions corresponding to values for MCPR where $\text{MCPR} < 1.0$ for each probability distribution from step (f);
- h) perturbing one or more of said parametric quantities and recalculating another value for NRSBT;
- i) repeating steps (c) through (h) for a predetermined number of perturbations;
- j) developing a histogram of NRSBT values calculated in steps (g) through (h);
- k) calculating a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values compiled in step (j);
- l) calculating a confidence interval for the nominal NRSBT value;
- m) selecting an OLMCPR for the reactor as the initial minimal MCPR such that, for a simulation of the most limiting operational event the nominal NRSBT value at a prescribed level of confidence remains less than a predetermined cutoff value; and
- n) effecting said BWR operation by applying the OLMCPR selected in step (l) as an operational control parameter.

2. The method of clause 1 wherein the operational event is a transient event associated with an Anticipated Operational Occurrence (AOO).

3. The method of clause 1, wherein multi-dimensional modeling of reactor thermal hydraulics and power is used to simulate an anticipated operational occurrence.

4. The method of clause 1, wherein the parametric quantities correspond to reactor plant state values and/or modeling parameters.

5. The method of clause 1, wherein step (d) the anticipated occurrence is simulated for a plurality of fuel rods simultaneously.

6. The method of clause 1, wherein said perturbing of one or more of said parametric quantities is accomplished using a Monte-Carlo statistical analysis approach.

7. A system for determining an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR), said system comprising a computer including a storage memory and I/O devices, said memory having stored therein rules for simultaneously simulating and evaluating thermal operating characteristics for a plurality of fuel rods during an anticipated operational occurrence of the reactor and a data base of one or more parametric quantities representing reactor plant operational state values and/or fuel rod modeling parameters, said computer programmed to:

- (i) simulate an anticipated operational occurrence for the reactor;
- (ii) determine a minimum critical power ratio (MCPR) for each individual fuel rod simulated based on a predetermined probability distribution $P(\Delta\text{CPR}/\text{ICPR})$ of potential change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) values for said anticipated operational occurrence;
- (iii) calculate a probability distribution $P(\text{MCPR})$ of potential MCPR values for each MCPR value;
- (iv) calculate a value for a number of fuel rods subject to boiling transition (NRSBT) by summing portions of probability distributions corresponding to values for MCPR where $\text{MCPR} < 1.0$ for all rods simulated, then repetitively calculate further values for NRSBT after perturbing one or more of said parametric quantities for a predetermined number of different perturbations;
- (v) develop a histogram of calculated NRSBT values over all perturbations; and
- (vi) select the OLMCPR from a minimal MCPR such that, for a simulation of the most limiting operational event, the nominal NRSBT value at a prescribed level of confidence as determined from analysis of the histogram determined from step (v) remains less than a predetermined cutoff value.

8. The system of clause 7 wherein the operational event simulated is a transient event associated with an Anticipated Operational Occurrences (AOO)

9. The system of clause 7 wherein a multi-dimensional modeling of fuel rod thermal hydraulics and reactor power is used to simulate an anticipated operational occurrence.

10. The system of clause 7 wherein step said anticipated occurrence is simulated for a plurality of fuel rods simultaneously.

11. A computer program product embodied on a computer readable medium for determining an operating limit minimum critical power ratio (OLMCPR) for a Boiling Water Reactor (BWR), comprising:

first instruction sequence means for performing a multi-dimensional simulation of reactor thermal hydraulics and power during an operational event in the reactor using a predetermined probability distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said operational event; and
 second instruction sequence means, coupled to said first instruction means, for directly calculating an OLMCPR value based on a statistic evaluation of a minimum critical power ratio (MCPR) for each fuel rod, as obtained from said first instruction sequence means, and for developing a histogram of possible NRSBT (number of fuel rods subject to boiling transition) values calculated from perturbations of predetermined reactor plant state values and fuel rod modeling parameters.

12. The computer program of clause 11 wherein said means for performing a multi-dimensional simulation of reactor thermal hydraulics and power simulates a transient operational occurrence for a plurality of fuel rods simultaneously.

13. A method for evaluating the operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR), comprising the steps, executed by a computer, of:

- a) setting a minimum critical power ratio (MCPR) for each of a plurality of individual nuclear fuel rods used in the reactor;
- b) calculating a value for a total number of fuel rods subject to boiling transition (NRSBT) based on a predetermined distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$);
- c) perturbing one or more reactor plant state value and/or fuel rod modeling parameter and recalculating a value for NRSBT;
- d) performing step (c) for a predetermined number of perturbations;
- e) developing a histogram of NRSBT values determined in steps (b), (c) and (d); and
- f) selecting the OLMCPR from a minimal MCPR such that, for a simulation of the most limiting operational event, the nominal NRSBT value at a prescribed level of confidence as determined from analysis of the histogram determined from step (e) remains less than a predetermined cutoff value.

14. The method of clause 13 wherein the calculating of an NRSBT value in step (b) is accomplished by the steps of:

determining a probability distribution $P(\text{MCPR})$ to each MCPR value set in step (a), said $P(\text{MCPR})$ indicative of a range of possible MCPR values resulting from various operational and design uncertainties; and
 integrating the probability distribution for values of $\text{MCPR} < 1.0$ for each fuel rod and summing the integration results for all fuel rods.

15. The method of clause 13 wherein the perturbing in step (c) of one or more reactor plant state value(s) and/or modeling parameter(s) is accomplished using randomly generated variations of said values and parameters.

16. For a nuclear fuel core of a Boiling Water Reactor, wherein fuel design and/or core configuration are contingent upon an operating margin for the reactor, said operating margin being determined by a process for evaluating an operating limit minimum critical power ratio (OLMCPR), an improved process for evaluating an OLMCPR and operating a Boiling Water Reactor which results in an improved operating margin for the reactor, comprising the steps of:

- a) developing in a memory of a computer system a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of computer simulations of a transient operational occurrence in a reactor based on a predetermined probability distribution of the change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$), said simulations providing values for a critical power ratio (CPR) for one or more fuel rods for a multiple of different parametric quantities for said reactor;
- b) selecting a nominal NRSBT value, based on a central tendency of NRSBT distribution, statistically determined by said computer system from the histogram of NRSBT values developed in step (a);
- c) selecting a confidence interval for the nominal NRSBT value;

- d) selecting an OLMCPR value from a minimal CPR such that during a simulation of a limiting transient operational occurrence the nominal NRSBT value remains less than a predetermined cutoff value; and
- e) effecting said Boiling Water Reactor operation by applying the OLMCPR selected in step (d) as an operational control parameter.

17. The method clause 16 wherein said histogram is developed on a data processing system using multi-dimensional modeling of transient operational occurrences, said data processing system including memory to store CPR data obtained from said simulations.

18. For a nuclear fuel core of a Boiling Water Reactor, wherein fuel rod design and/or core configuration are contingent upon an operating margin for the reactor, said operating margin being determined by a process for evaluating an operating limit minimum critical power ratio (OLMCPR), a improved process for evaluating an OLMCPR and operating a Boiling Water Reactor that results in an increased operating margin for the reactor, comprising the steps, executed by a computer, of:

- a) developing in a memory of said computer a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of computer simulations of a transient operational occurrence in a reactor, said simulations providing values for a critical power ratio (CPR) for one or more fuel rods for a multiple of different parametric quantities for said reactor, said simulations based on a predetermined probability distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said transient operational occurrence;
- b) calculating a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values obtained in step (a);
- c) selecting a confidence interval for the nominal NRSBT value;
- d) selecting an OLMCPR for the reactor as the initial minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value; and
- e) effecting Boiling Water Reactor operation by applying the OLMCPR selected in step (d) as an operational control parameter.

19. A method for statistically demonstrating an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR) for compliance with licensing requirements, said reactor characterized by one or more parametric quantities indicative of design constraints and operating conditions, comprising the steps of:

- a) programming a computer to determine an OLMCPR value for a boiling water reactor, said computer programmed at least to:

- i) develop a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of simulations of a transient operational occurrence in a reactor, said simulations providing values for a critical power ratio (CPR) for one or more fuel rods over a multiple of randomly selected variations in the parametric quantities for said reactor, said simulations based on a predetermined probability distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said transient operational occurrence;
- ii) calculate a nominal NRSBT value from the histogram of NRSBT values; and
- iii) select an OLMCPR for the reactor corresponding to a minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value; and

- b) providing said OLMCPR value to an output device for display, recordation or storage.

20. For use in controlling a Boiling Water Reactor having a nuclear fueled core characterized by an operating limit minimum critical power ratio (OLMCPR) value, a method for determining said OLMCPR value comprising the steps of:

- a) using a computer to simulate transient operational occurrences based on predetermined distributions of said occurrences which might occur during the operation of a Boiling Water Reactor;
- b) developing a histogram of NRSBT values from a computer simulation of a transient operational occurrence in a Boiling Water Reactor, the simulation providing values for a critical power ratio (CPR) for one or more fuel rods;
- c) determining a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values obtained in step (a);
- d) selecting a confidence interval for the nominal NRSBT value; and

e) selecting an OLMCPR for the reactor as the initial minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value.

5 Claims

1. A method for direct evaluation of an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR) using computer simulation(s) of postulated operational events and previously determined translations in change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for transient events, said reactor described by one or more parametric quantities indicative of design constraints and operating conditions, comprising the steps:

- a) determining a probability distribution $P(\Delta\text{CPR}/\text{ICPR})$ of potential $\Delta\text{CPR}/\text{ICPR}$ for the class of BRW, operational event, and fuel type;
- b) initializing said parametric quantities to nominal values;
- c) determining steady state initial conditions of reactor operation;
- d) simulating an operational event for a plurality of fuel rods in a BWR core;
- e) calculating a minimum critical power ratio (MCPR) for each fuel rod simulated in step (d) using the probability distribution obtained in step (a);
- f) determining a probability distribution $P(\text{MCPR})$ of potential MCPR values for each MCPR value obtained in step (e);
- g) calculating a value for a total number of fuel rods subject to boiling transition (NRSBT) by summing portions of probability distributions corresponding to values for MCPR where $\text{MCPR} < 1.0$ for each probability distribution from step (f);
- h) perturbing one or more of said parametric quantities and recalculating another value for NRSBT;
- i) repeating steps (c) through (h) for a predetermined number of perturbations;
- j) developing a histogram of NRSBT values calculated in steps (g) through (h);
- k) calculating a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values compiled in step (j);
- l) calculating a confidence interval for the nominal NRSBT value;
- m) selecting an OLMCPR for the reactor as the initial minimal MCPR such that, for a simulation of the most limiting operational event the nominal NRSBT value at a prescribed level of confidence remains less than a predetermined cutoff value; and
- n) effecting said BWR operation by applying the OLMCPR selected in step (l) as an operational control parameter.

2. The method of claim 1 wherein the operational event is a transient event associated with an Anticipated Operational Occurrence (AOO).

3. A system for determining an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR), said system comprising a computer including a storage memory and I/O devices, said memory having stored therein rules for simultaneously simulating and evaluating thermal operating characteristics for a plurality of fuel rods during an anticipated operational occurrence of the reactor and a data base of one or more parametric quantities representing reactor plant operational state values and/or fuel rod modeling parameters, said computer programmed to:

- (i) simulate an anticipated operational occurrence for the reactor;
- (ii) determine a minimum critical power ratio (MCPR) for each individual fuel rod simulated based on a predetermined probability distribution $P(\Delta\text{CPR}/\text{ICPR})$ of potential change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) values for said anticipated operational occurrence;
- (iii) calculate a probability distribution $P(\text{MCPR})$ of potential MCPR values for each MCPR value;
- (iv) calculate a value for a number of fuel rods subject to boiling transition (NRSBT) by summing portions of probability distributions corresponding to values for MCPR where $\text{MCPR} < 1.0$ for all rods simulated, then repetitively calculate further values for NRSBT after perturbing one or more of said parametric quantities for a predetermined number of different perturbations;
- (v) develop a histogram of calculated NRSBT values over all perturbations; and
- (vi) select the OLMCPR from a minimal MCPR such that, for a simulation of the most limiting operational event, the nominal NRSBT value at a prescribed level of confidence as determined from analysis of the histogram determined from step (v) remains less than a predetermined cutoff value.

4. The system of claim 3 wherein the operational event simulated is a transient event associated with an Anticipated Operational Occurrences (AOO)

5. A computer program product embodied on a computer readable medium for determining an operating limit minimum critical power ratio (OLMCPR) for a Boiling Water Reactor (BWR), comprising:

first instruction sequence means for performing a multi-dimensional simulation of reactor thermal hydraulics and power during an operational event in the reactor using a predetermined probability distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said operational event; and

second instruction sequence means, coupled to said first instruction means, for directly calculating an OLMCPR value based on a statistic evaluation of a minimum critical power ratio (MCPR) for each fuel rod, as obtained from said first instruction sequence means, and for developing a histogram of possible NRSBT (number of fuel rods subject to boiling transition) values calculated from perturbations of predetermined reactor plant state values and fuel rod modeling parameters.

6. A method for evaluating the operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR), comprising the steps, executed by a computer, of:

a) setting a minimum critical power ratio (MCPR) for each of a plurality of individual nuclear fuel rods used in the reactor;

b) calculating a value for a total number of fuel rods subject to boiling transition (NRSBT) based on a predetermined distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$);

c) perturbing one or more reactor plant state value and/or fuel rod modeling parameter and recalculating a value for NRSBT;

d) performing step (c) for a predetermined number of perturbations;

e) developing a histogram of NRSBT values determined in steps (b), (c) and (d); and

f) selecting the OLMCPR from a minimal MCPR such that, for a simulation of the most limiting operational event, the nominal NRSBT value at a prescribed level of confidence as determined from analysis of the histogram determined from step (e) remains less than a predetermined cutoff value.

7. For a nuclear fuel core of a Boiling Water Reactor, wherein fuel design and/or core configuration are contingent upon an operating margin for the reactor, said operating margin being determined by a process for evaluating an operating limit minimum critical power ratio (OLMCPR), an improved process for evaluating an OLMCPR and operating a Boiling Water Reactor which results in an improved operating margin for the reactor, comprising the steps of:

a) developing in a memory of a computer system a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of computer simulations of a transient operational occurrence in a reactor based on a predetermined probability distribution of the change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$), said simulations providing values for a critical power ratio (CPR) for one or more fuel rods for a multiple of different parametric quantities for said reactor;

b) selecting a nominal NRSBT value, based on a central tendency of NRSBT distribution, statistically determined by said computer system from the histogram of NRSBT values developed in step (a);

c) selecting a confidence interval for the nominal NRSBT value;

d) selecting an OLMCPR value from a minimal CPR such that during a simulation of a limiting transient operational occurrence the nominal NRSBT value remains less than a predetermined cutoff value; and

e) effecting said Boiling Water Reactor operation by applying the OLMCPR selected in step (d) as an operational control parameter.

8. A process for evaluating an operating limit minimum critical power ratio (OLMCPR) for a nuclear fuel core of a Boiling Water Reactor that results in an increased operating margin for the reactor, wherein fuel rod design and/or core configuration are contingent upon an operating margin for the reactor, said operating margin being determined by a process for evaluating OLMCPR, the process comprising the steps, executed by a computer, of:

a) developing in a memory of said computer a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of computer simulations of a transient operational occurrence in a reactor, said simulations providing values for a critical power ratio (CPR) for one or more fuel rods for a multiple of different parametric quantities for said reactor, said simulations based on a predetermined proba-

bility distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said transient operational occurrence;
 b) calculating a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values obtained in step (a);
 c) selecting a confidence interval for the nominal NRSBT value;
 d) selecting an OLMCPR for the reactor as the initial minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value; and
 e) effecting Boiling Water Reactor operation by applying the OLMCPR selected in step (d) as an operational control parameter.

9. A method for statistically demonstrating an operating limit minimum critical power ratio (OLMCPR) of a boiling water reactor (BWR) for compliance with licensing requirements, said reactor **characterized by** one or more parametric quantities indicative of design constraints and operating conditions, comprising the steps of:

a) programming a computer to determine an OLMCPR value for a boiling water reactor, said computer programmed at least to:

- i) develop a histogram of NRSBT (number of fuel rods subject to boiling transition) values, corresponding to a plurality of simulations of a transient operational occurrence in a reactor, said simulations providing values for a critical power ratio (CPR) for one or more fuel rods over a multiple of randomly selected variations in the parametric quantities for said reactor, said simulations based on a predetermined probability distribution of change in critical power ratio ($\Delta\text{CPR}/\text{ICPR}$) for said transient operational occurrence;
 ii) calculate a nominal NRSBT value from the histogram of NRSBT values; and
 iii) select an OLMCPR for the reactor corresponding to a minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value; and

b) providing said OLMCPR value to an output device for display, recordation or storage.

10. For use in controlling a Boiling Water Reactor having a nuclear fueled core **characterized by** an operating limit minimum critical power ratio (OLMCPR) value, a method for determining said OLMCPR value comprising the steps of:

- a) using a computer to simulate transient operational occurrences based on predetermined distributions of said occurrences which might occur during the operation of a Boiling Water Reactor;
 b) developing a histogram of NRSBT values from a computer simulation of a transient operational occurrence in a Boiling Water Reactor, the simulation providing values for a critical power ratio (CPR) for one or more fuel rods;
 c) determining a nominal NRSBT value, based on a central tendency of an NRSBT distribution, from the histogram of NRSBT values obtained in step (a);
 d) selecting a confidence interval for the nominal NRSBT value; and
 e) selecting an OLMCPR for the reactor as the initial minimal MCPR such that during a simulation of a transient the nominal NRSBT value remains less than a predetermined cutoff value.

FIG. 1

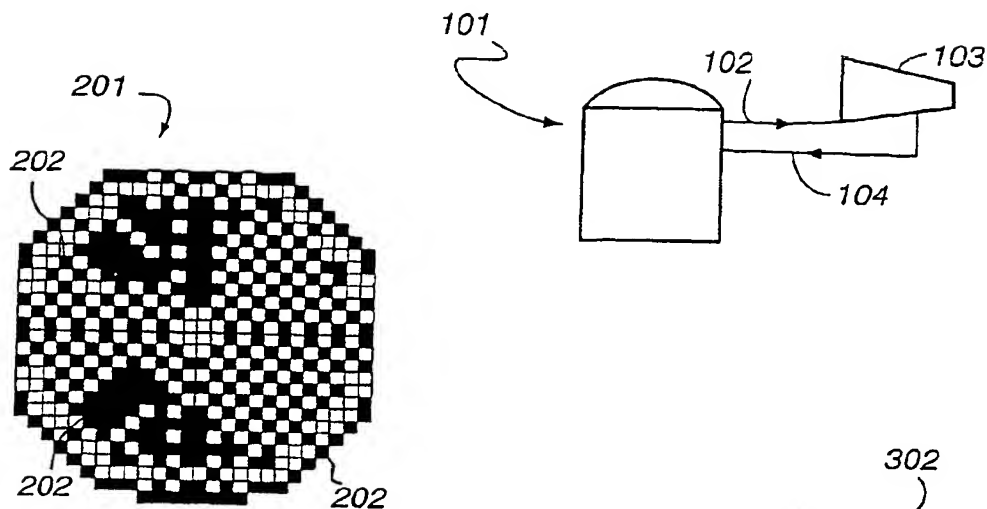
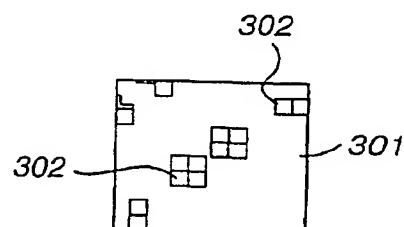
**FIG. 2**

FIG. 3

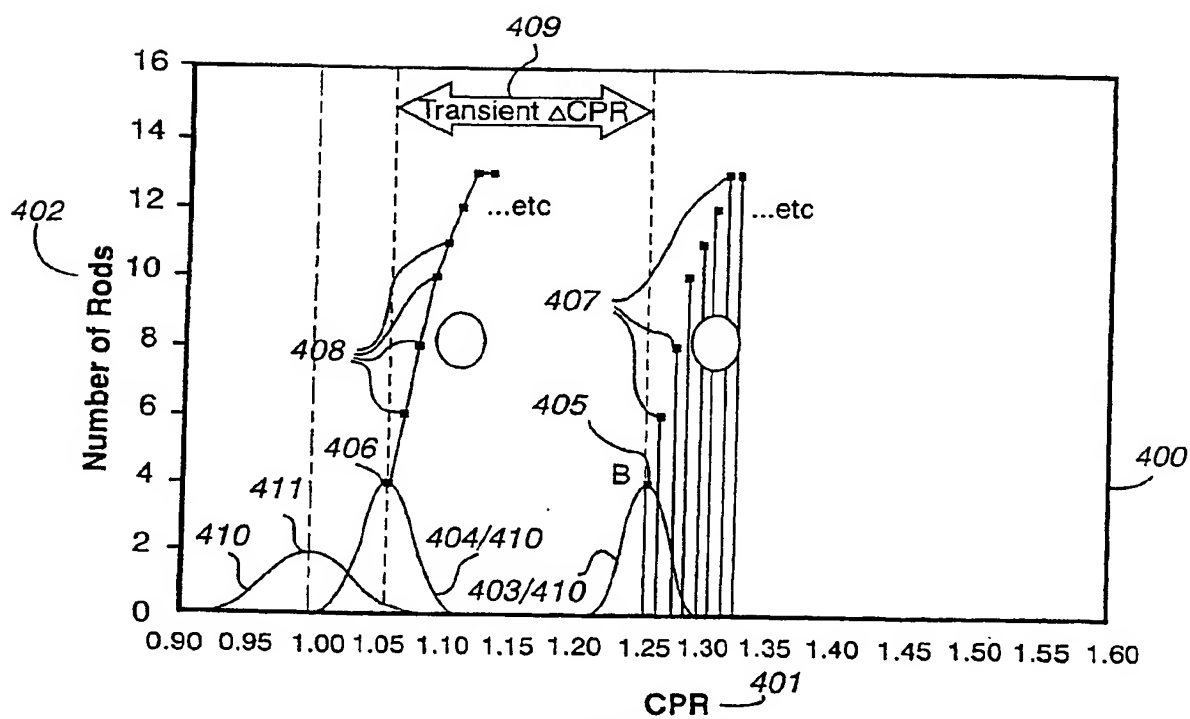


FIG. 4

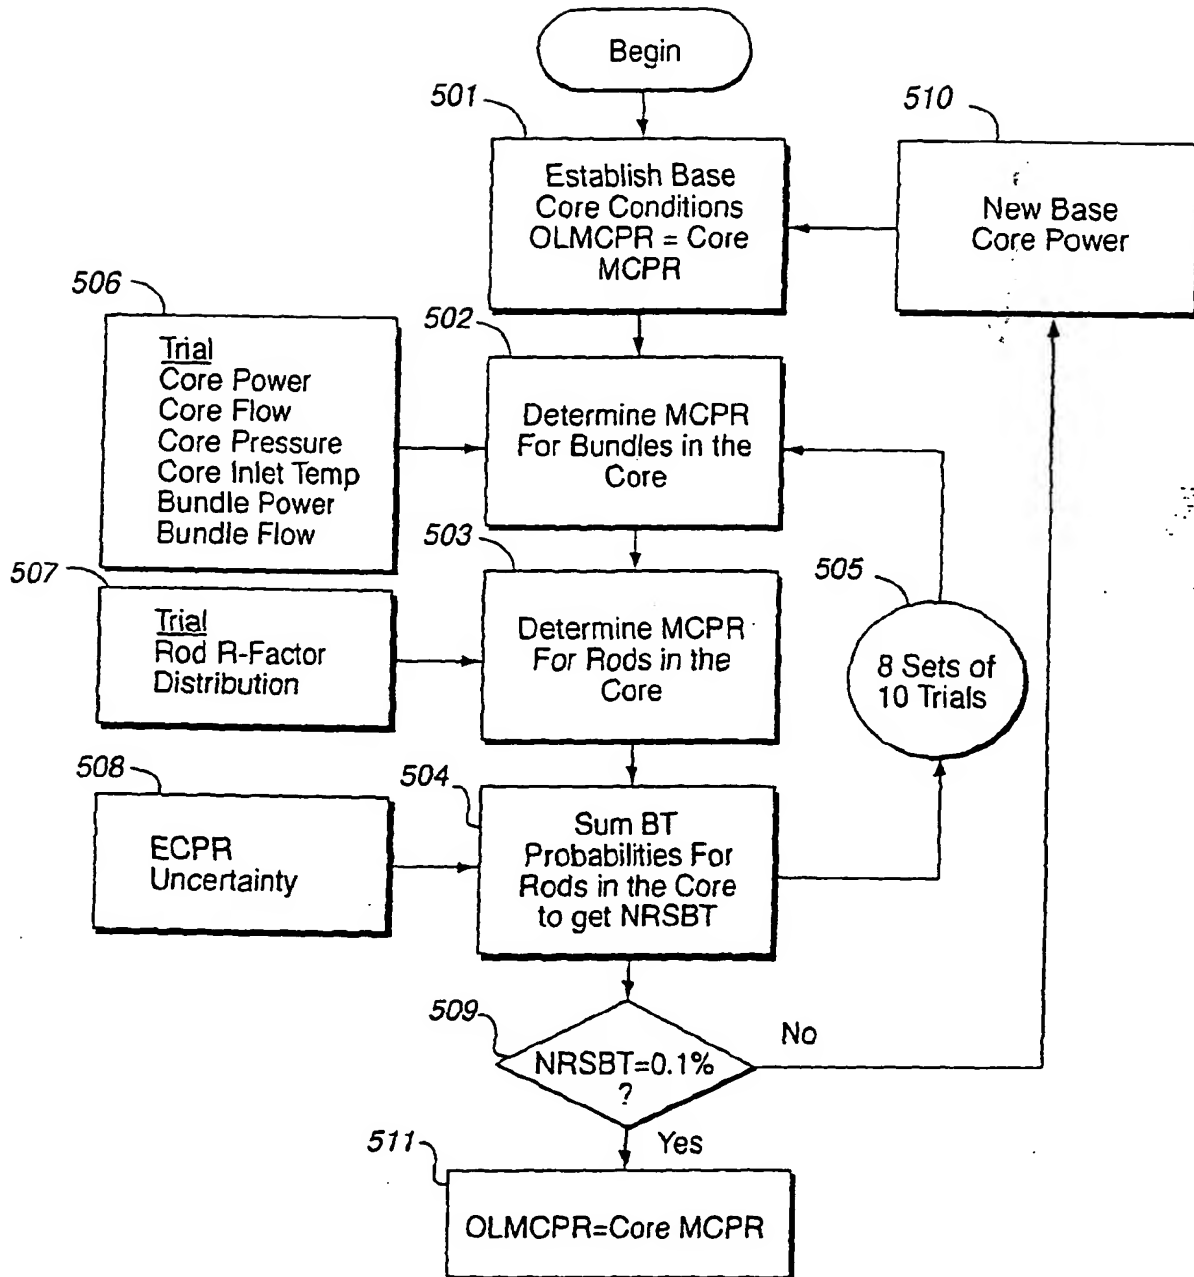
FIG. 5



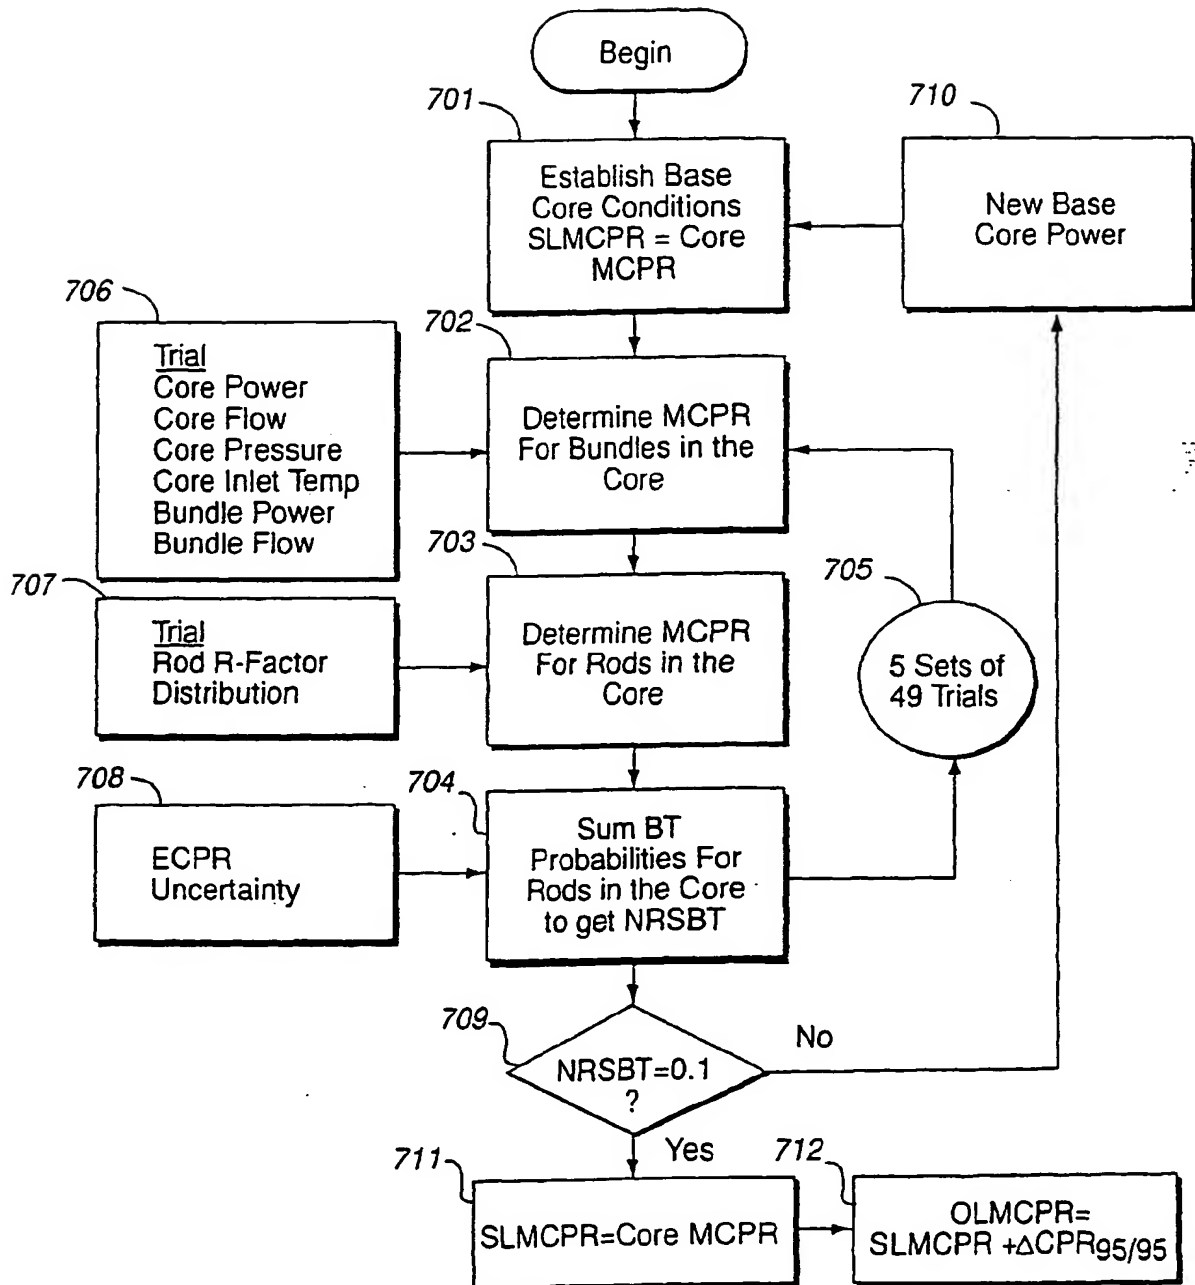
FIG. 7

FIG. 8

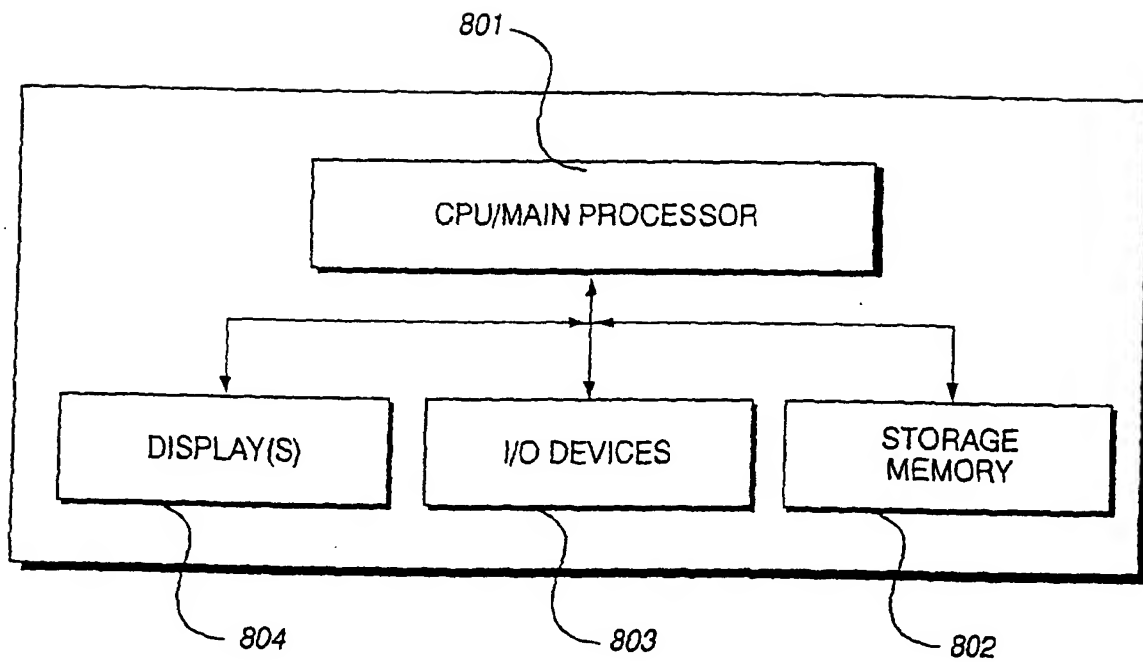


FIG. 9

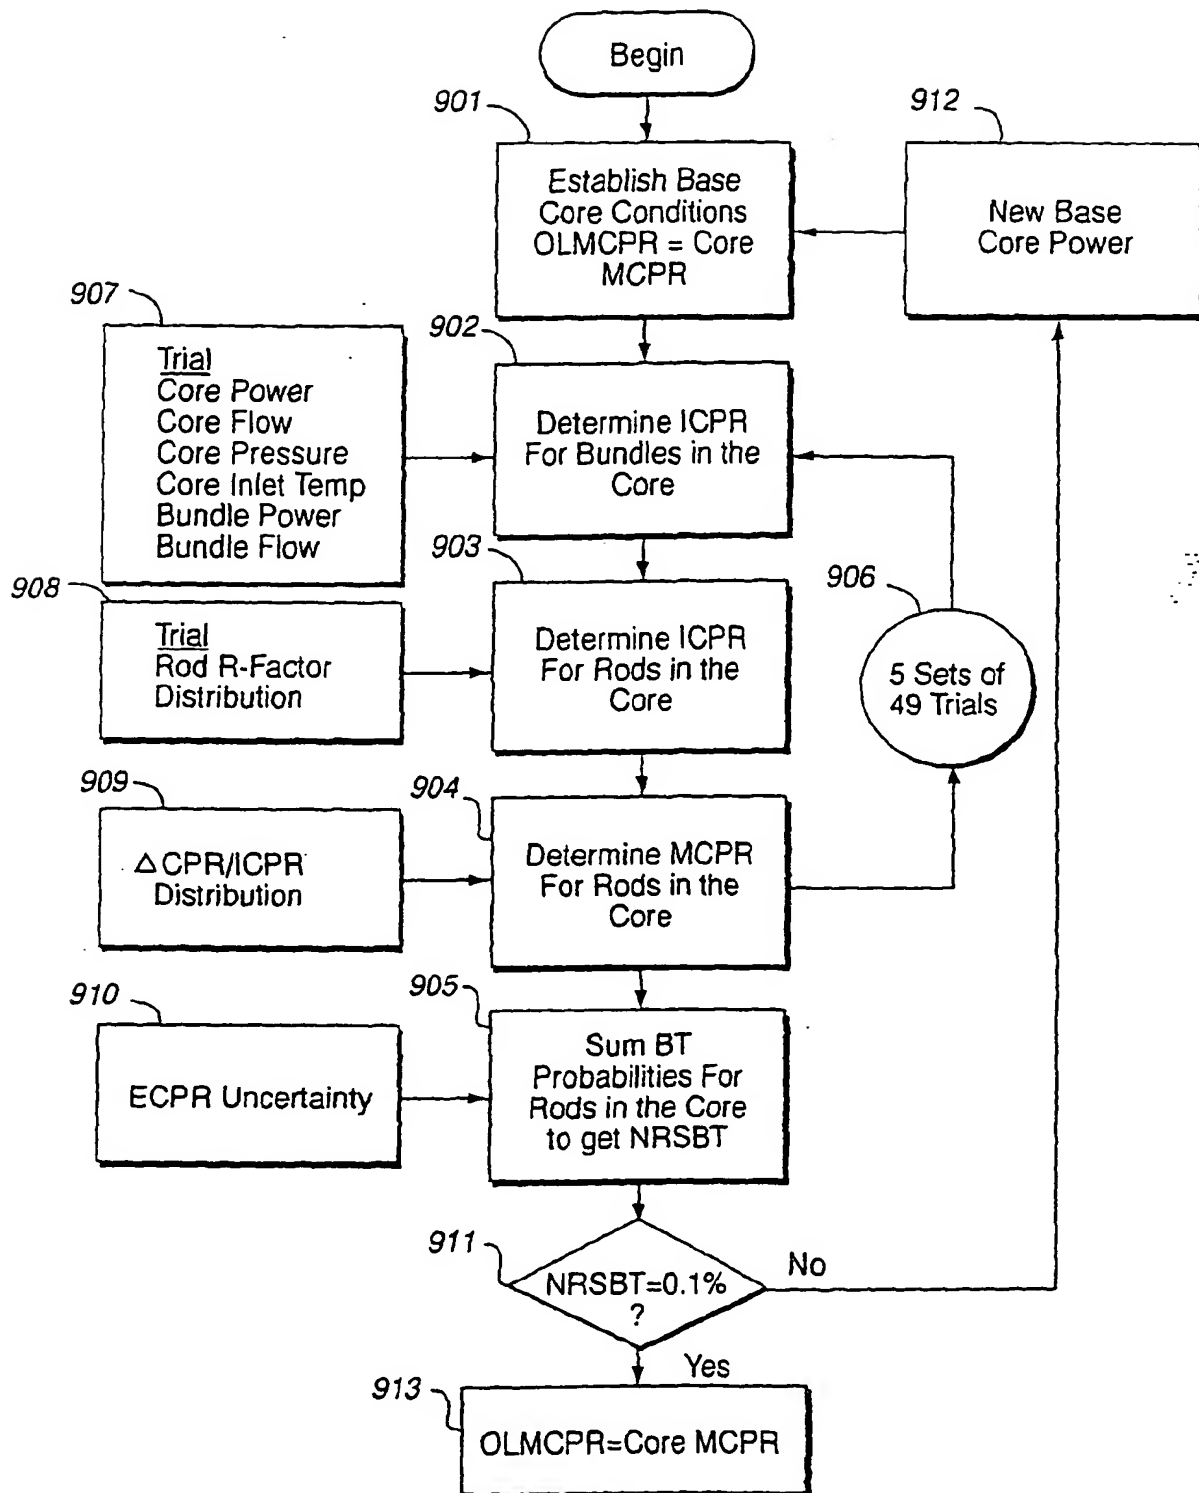


FIG. 10

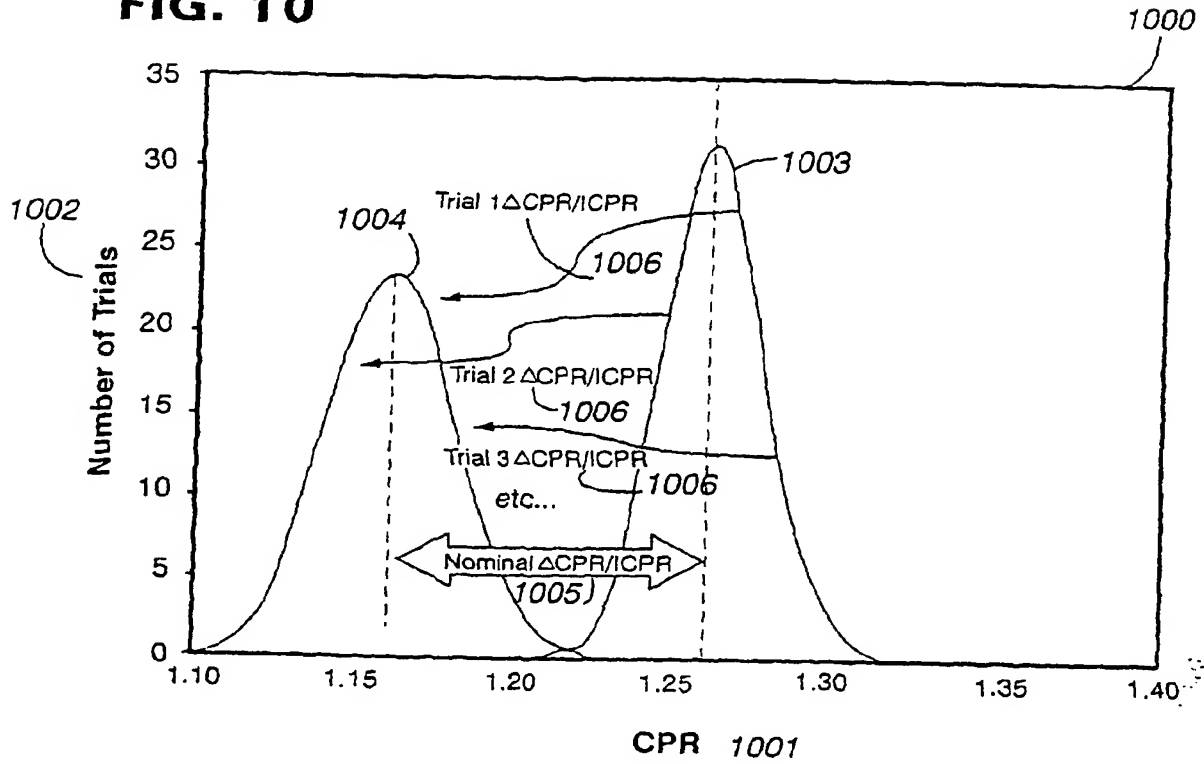


FIG. 11

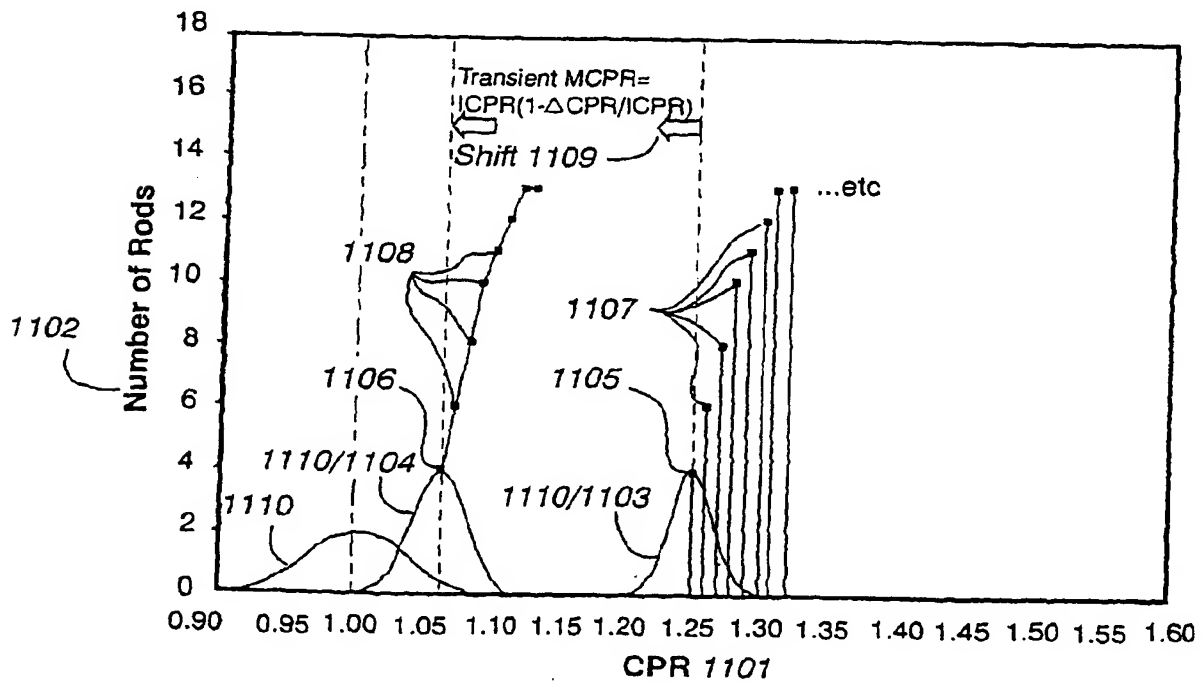


FIG. 12

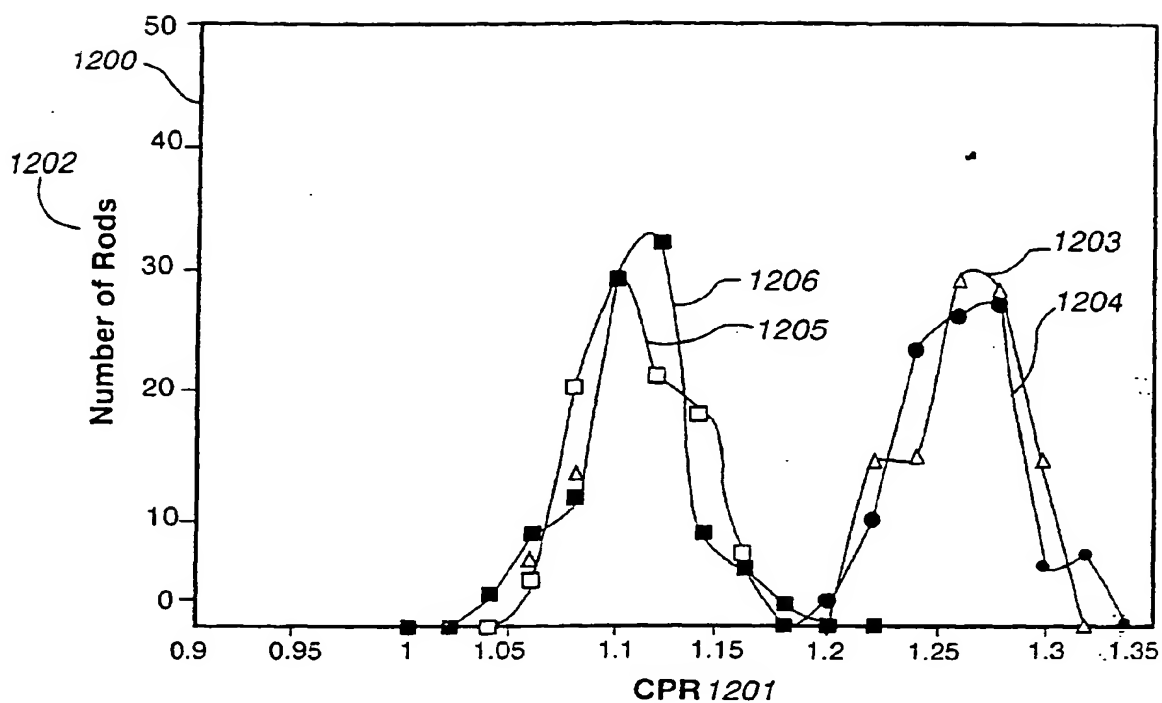
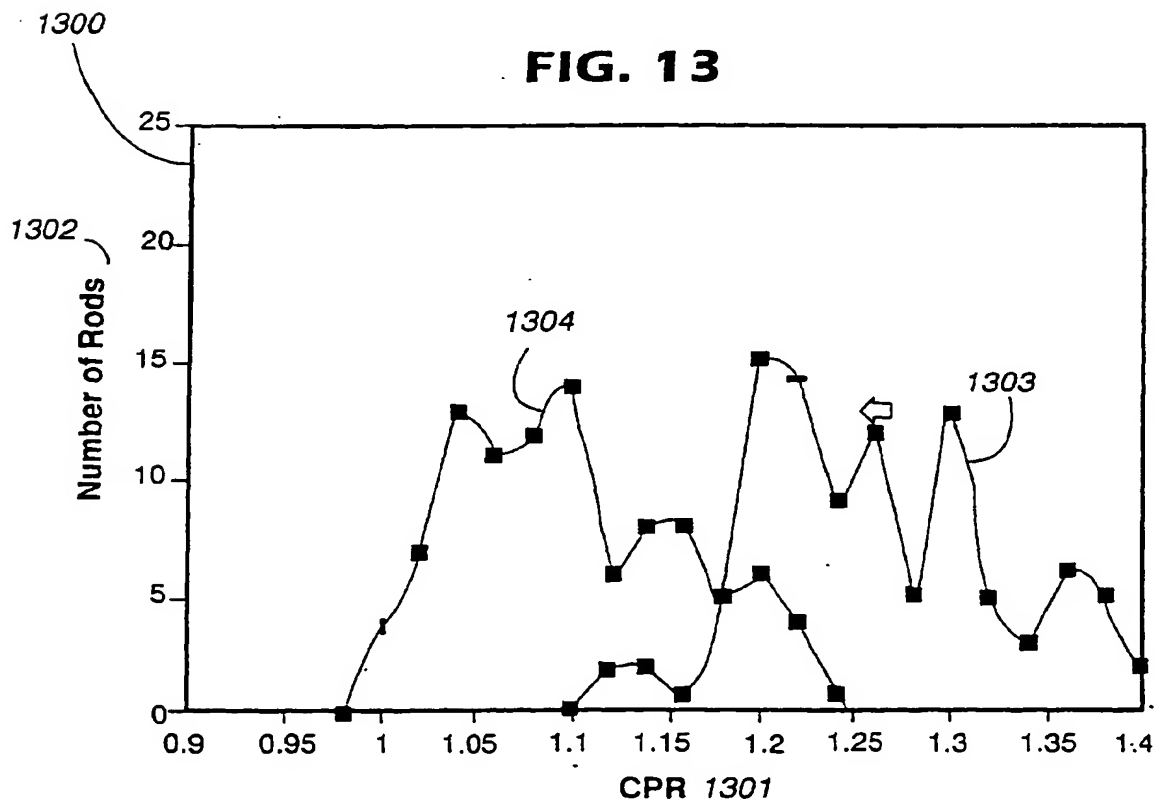


FIG. 13





European Patent
Office

EUROPEAN SEARCH REPORT

Application Number
EP 01 31 0704

DOCUMENTS CONSIDERED TO BE RELEVANT			
Category	Citation of document with indication, where appropriate, of relevant passages	Relevant to claim	CLASSIFICATION OF THE APPLICATION (Int.Cl.7)
X, D	US 5 912 933 A (ANDERSEN JENS G M ET AL) 15 June 1999 (1999-06-15) * column 5, line 5 - column 6, line 10 * * column 6, line 55 - column 9, line 49; claim 1; figures 1-5 *	1-10	G21D3/04
A	US 5 171 516 A (IWAMOTO TATSUYA) 15 December 1992 (1992-12-15) * abstract * * column 1, line 8-19 * * claim 1; figures 1,6 *	1-10	
A	EP 0 405 863 A (GEN ELECTRIC) 2 January 1991 (1991-01-02) * page 11, line 20-50 * * page 18-20; figures 1,3 *	1-10	
A	PATENT ABSTRACTS OF JAPAN vol. 014, no. 358 (P-1087), 2 August 1990 (1990-08-02) & JP 02 130498 A (NIPPON ATOM IND GROUP CO LTD; OTHERS: 01), 18 May 1990 (1990-05-18) * abstract *	1-10	
The present search report has been drawn up for all claims			TECHNICAL FIELDS SEARCHED (Int.Cl.7)
			G21D
Place of search	Date of completion of the search	Examiner	
THE HAGUE	8 May 2002	Jandl, F	
CATEGORY OF CITED DOCUMENTS		I : theory or principle underlying the invention E : earlier patent document, but published on, or after the filing date D : document cited in the application L : document cited for other reasons & : member of the same patent family, corresponding document	
X : particularly relevant if taken alone Y : particularly relevant if combined with another document of the same category A : technological background O : non-written disclosure P : intermediate document			

EPC FORM 1503 03 82 (POCC)

**ANNEX TO THE EUROPEAN SEARCH REPORT
ON EUROPEAN PATENT APPLICATION NO.**

EP 01 31 0704

This annex lists the patent family members relating to the patent documents cited in the above-mentioned European search report. The members are as contained in the European Patent Office EDP file on
The European Patent Office is in no way liable for these particulars which are merely given for the purpose of information.

08-05-2002

Patent document cited in search report		Publication date	Patent family member(s)		Publication date
US 5912933	A	15-06-1999	NONE		
<hr/>					
US 5171516	A	15-12-1992	JP	3224810 B2	05-11-2001
			JP	4142498 A	15-05-1992
<hr/>					
EP 0405863	A	02-01-1991	US	5091139 A	25-02-1992
			DE	69022305 D1	19-10-1995
			DE	69022305 T2	04-04-1996
			EP	0405863 A2	02-01-1991
			ES	2078946 T3	01-01-1996
			JP	2038822 C	28-03-1996
			JP	3065693 A	20-03-1991
			JP	7069451 B	31-07-1995
<hr/>					
JP 02130498	A	18-05-1990	NONE		
<hr/>					

EPC FORM P/459

For more details about this annex : see Official Journal of the European Patent Office, No. 12/82

THIS PAGE BLANK (USPTO)